



Cross C o n n e c t i o n s

A cross connection is an arrangement of piping which could allow undesirable water, sewage, or chemical solutions to enter your drinking (potable) water system as a result of back-flow. Cross connections with potable piping system have resulted in numerous cases of illness and even death.


Historically, cross connections have been one of the most serious public health threats to a drinking water supply system, and many times present in a residential water system.

What is backflow and

how can it occur?

Backflow is the reversal of normal flow in a system due to backsiphonage or backpressure.

Backsiphonage backflow occurs when a vacuum is induced on a piping system, just like drinking from a glass with a drinking straw. A garden hose or a hose connected to a laundry tub can act as a "drinking straw" allowing undesirable liquids to be drawn through it by backsiphonage. Some typical situations which cause backsiphonage action include:

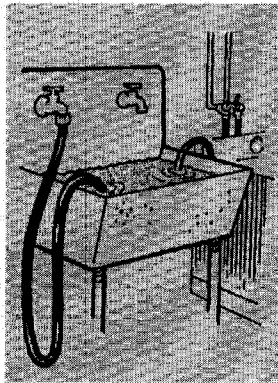

- watermain breaks or repairs occurring in the system at a point of lower elevation than your service point;
- high water flow rates exerted on a watermain due to fire fighting, hydrant flushing, large system demands or major piping breaks;
- booster pumps taking direct suction from potable water supply piping; or
- undersized piping.

Whenever the drinking water supply system is directly connected to another piping system or process which operates at a higher system pressure, backpressure backflow can occur. Typical causes of backpressure backflow include:

- nonpotable piping systems equipped with pumping equipment (irrigation well interconnected with a potable system, for example);
- steam or hot water boilers; or
- heat exchangers.

What is the law?

Cross connections with potable piping systems are prohibited by state plumbing codes. Additionally, Michigan water utilities are required to have a cross connection control inspection program of their water customers to eliminate and prevent cross connections. Common commercial and industrial users posing a public health threat include:

- industries with private wells;
- industries with chemically treated boilers;
- plating operations, chemical processing plants;
- funeral homes, mortuaries;
- marina facilities;
- hospitals, nursing homes;
- research laboratories;
- car washes, laundromats; and
- school facilities.

Most utilities have made inspections of these facilities and have had corrective action taken where necessary. However, due to a lack of staff resources, many utilities cannot effectively carry out a residential cross connection inspection

Whenever the drinking water supply system is directly connected to another piping system or process which operates at a higher system pressure, backpressure backflow can occur. Typical causes of backpressure backflow include:

- nonpotable piping systems equipped with pumping equipment (irrigation well interconnected with a potable system, for example);
- steam or hot water boilers; or
- heat exchangers.

What is the law?

Cross connections with potable piping systems are prohibited by state plumbing codes. Additionally, Michigan water utilities are required to have a cross connection control inspection program of their water customers to eliminate and prevent cross connections. Common commercial and industrial users posing a public health threat include:

- industries with private wells;
- industries with chemically treated boilers;
- plating operations, chemical processing plants;
- funeral homes, mortuaries;
- marina facilities;
- hospitals, nursing homes;
- research laboratories;
- car washes, laundromats; and
- school facilities.

Most utilities have made inspections of these facilities and have had corrective action taken where necessary. However, due to a lack of staff resources, many utilities cannot effectively carry out a residential cross connection inspection


program. Consequently, residential water users could remain a potential health threat to the public water supply system and to other system customers.

What hazards threaten the homeowner?

Many common household uses for water pose a public health threat to the potable water supply system whether the home is supplied by municipal water or by a private well. Principal areas of water use in the home that pose a threat due to cross connections are:

- a hose connection to a chemical solution aspirator to feed lawn/shrub herbicides, pesticides, and fertilizers;
- lawn irrigation systems;
- chemically treated heating systems;
- water softeners;
- hose connections to a water outlet or laundry tub;
- swimming pools;
- solar heating systems;
- private nonpotable water supplies;
- noncode (siphonable) ball cock assemblies in toilets; and
- water-operated sump drain devices.

This list of potential cross connection hazards is by no means complete. A private residence that has one or two of these situations is seriously jeopardizing its own potable water system and that of the community if it is served by a public water supply system.

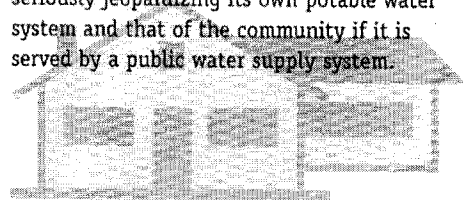

What can be done?

Homeowners as well as plant managers, business persons, administrators, and school officials all must share the responsibility to protect potable water piping systems from contamination through cross connections. Each should contact either the local water utility or the local health department for assistance in locating and correcting cross connection hazards. Residents supplied by private well sources must assume total control of their water system and safeguard it from contamination. In many instances involving residential cross connections, the installation of a hose bib (faucet) vacuum breaker can prevent backsiphonage of contaminants and provide adequate protection of the homeowner's water system and consequently, the utility's water system.

This means equipping each outside hose connection and hose connections in the basement and laundry room with a simple and inexpensive vacuum breaker. These devices can be obtained from hardware stores or plumbing shops for under \$10 each. In other instances, more elaborate protective devices may be necessary. For those situations, assistance in determining what device is appropriate may be needed.



HOSE BIBB VACUUM BREAKER

Questions concerning cross connection control and backflow prevention may be directed to the:

- ◆ Michigan Department of Environmental Quality
Drinking Water and Radiological Protection
Division, Field Operations Section
517-335-9216;
- ◆ Michigan Department of Consumer and
Industry Services
Bureau of Construction Codes, Plumbing
Division
517-241-9330;
- ◆ your local health department, or your local
water department.

Prepared by:

Michigan Department of Environmental Quality
Michigan Department of Consumer and Industry
Services, State Plumbing Board
Michigan Section, American Water Works Association



Printed on
Recycled Paper

Authority: P.A. 451 of 1994
Total Cost: \$195.80
Cost Per Copy: \$.097
Michigan Department of Environmental Quality **DEQ**



Printed by
**GREAT
PRINTER**

The Michigan Department of Environmental Quality (MDEQ) will not discriminate against any individual or group on the basis of race, sex, religion, age, national origin, color, marital status, disability, or political beliefs. Questions or concerns should be directed to the MDEQ Office of Personnel Services, PO Box 30473, Lansing, MI 48909.

Copyright 1982 Michigan Section, American Water Works
Association

For more information contact your local health department.

**Shiawassee County Environmental Health Division
201 N. Shiawassee St.
Corunna, Michigan 48817
(989) 743-2390**